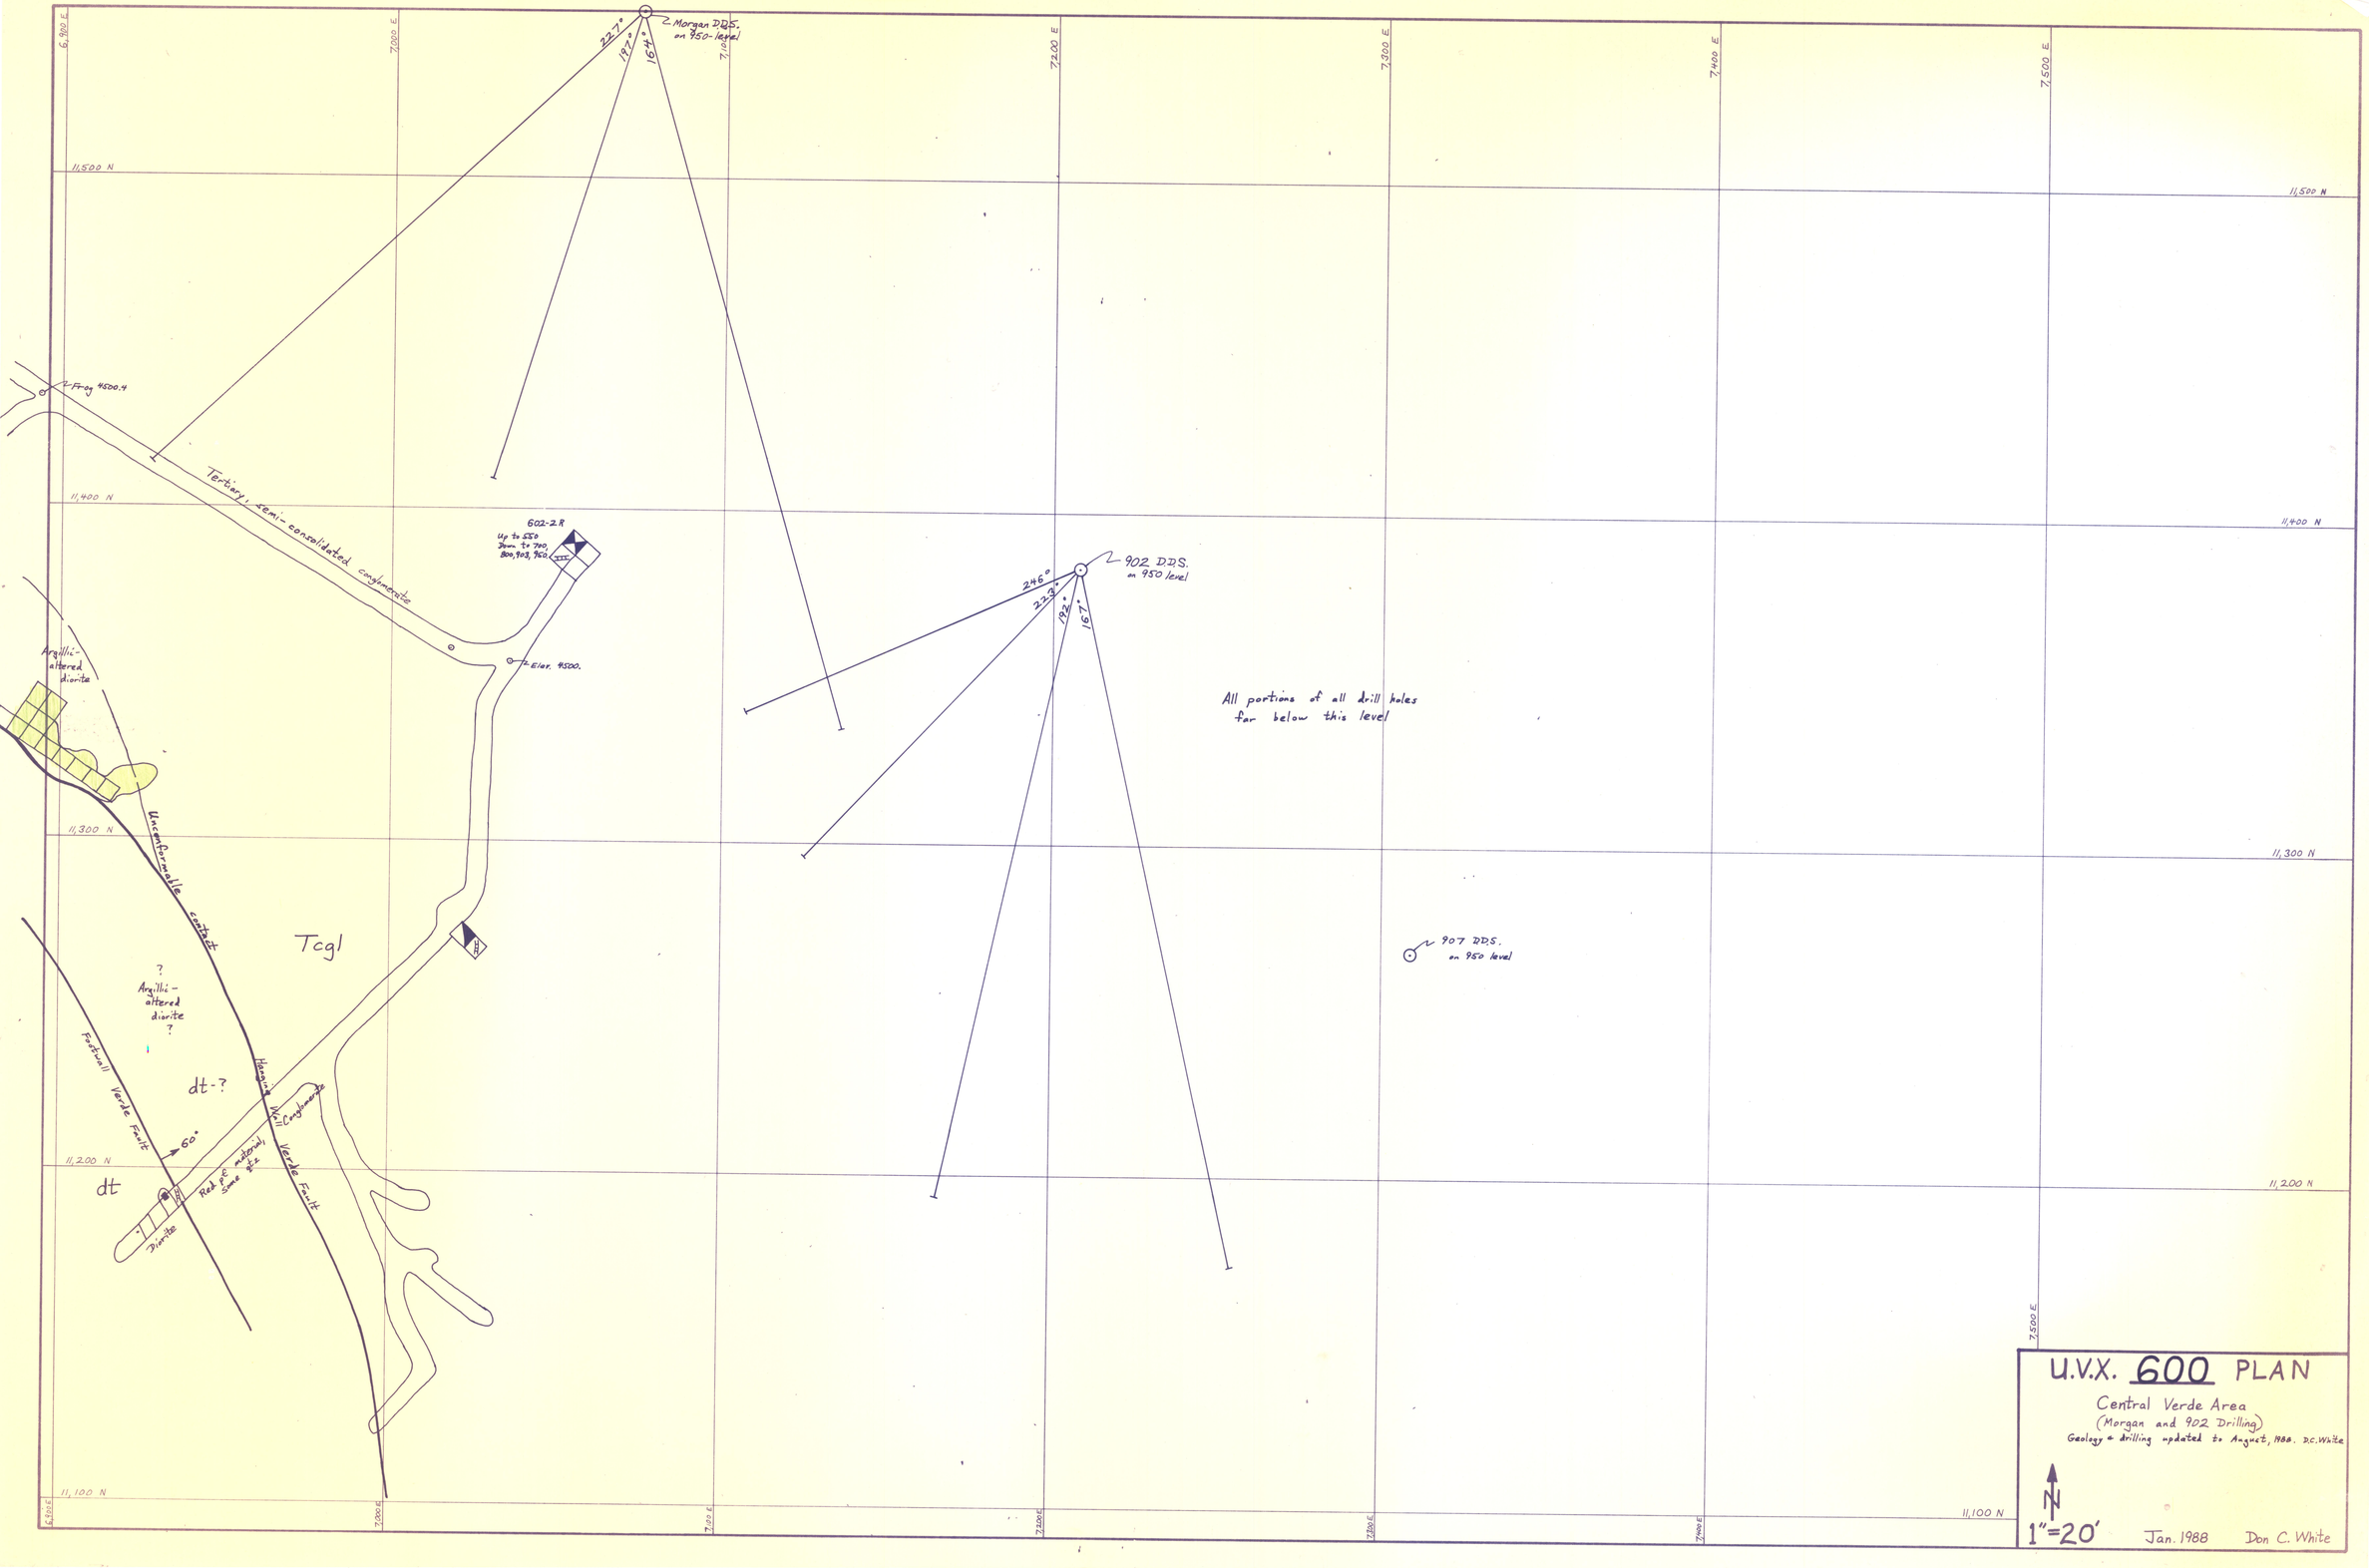
6,900 E
7,000 E
7,100 E
7,200 E
7,300 E
7,400 E
7,500 E
11,500 N
11,400 N
11,300 N
11,200 N
11,100 N
Morgan DDS. on 950-level
227°
197°
191°
Frog 4500.4
Tertiary, semi-consolidated conglomerate
602-2.R
Up to 550
Down to 700,
800, 903, 900
Elev. 4500.
902 DDS. on 950 level
246°
223°
193°
187°
All portions of all drill holes
far below this level
Argillic-altered diorite
Unconformable contact
Tcgl
?
Argillic-altered diorite
?
907 DDS. on 950 level
Footwall Verde Fault
dt-?
Hanging Wall Conglomerate
Verde Fault
60°
Red of material Same Rx
dt
Diorite
U.V.X. 600 PLAN
Central Verde Area
(Morgan and 902 Drilling)
Geology + drilling updated to August, 1988. DC. White
N
1"=20'
Jan. 1988
Don C. White